


**Chill Water System**

- CHS, CHILL WATER SUPPLY
- CHR, CHILL WATER RETURN
- CWS, CONDENSER WATER SUPPLY
- CWR, CONDENSER WATER RETURN
- HWS, HOT WATER SUPPLY
- HWR, HOT WATER RETURN
- PCCC, PUMPED COIL CONDENSATE
- ⌋ CAP
- ⋈ CHILL WATER VALVE
- CHILLER
- ~ CONTINUATION
- ⊗ COOLING TOWER



0 250 500 750 1,000  
Feet

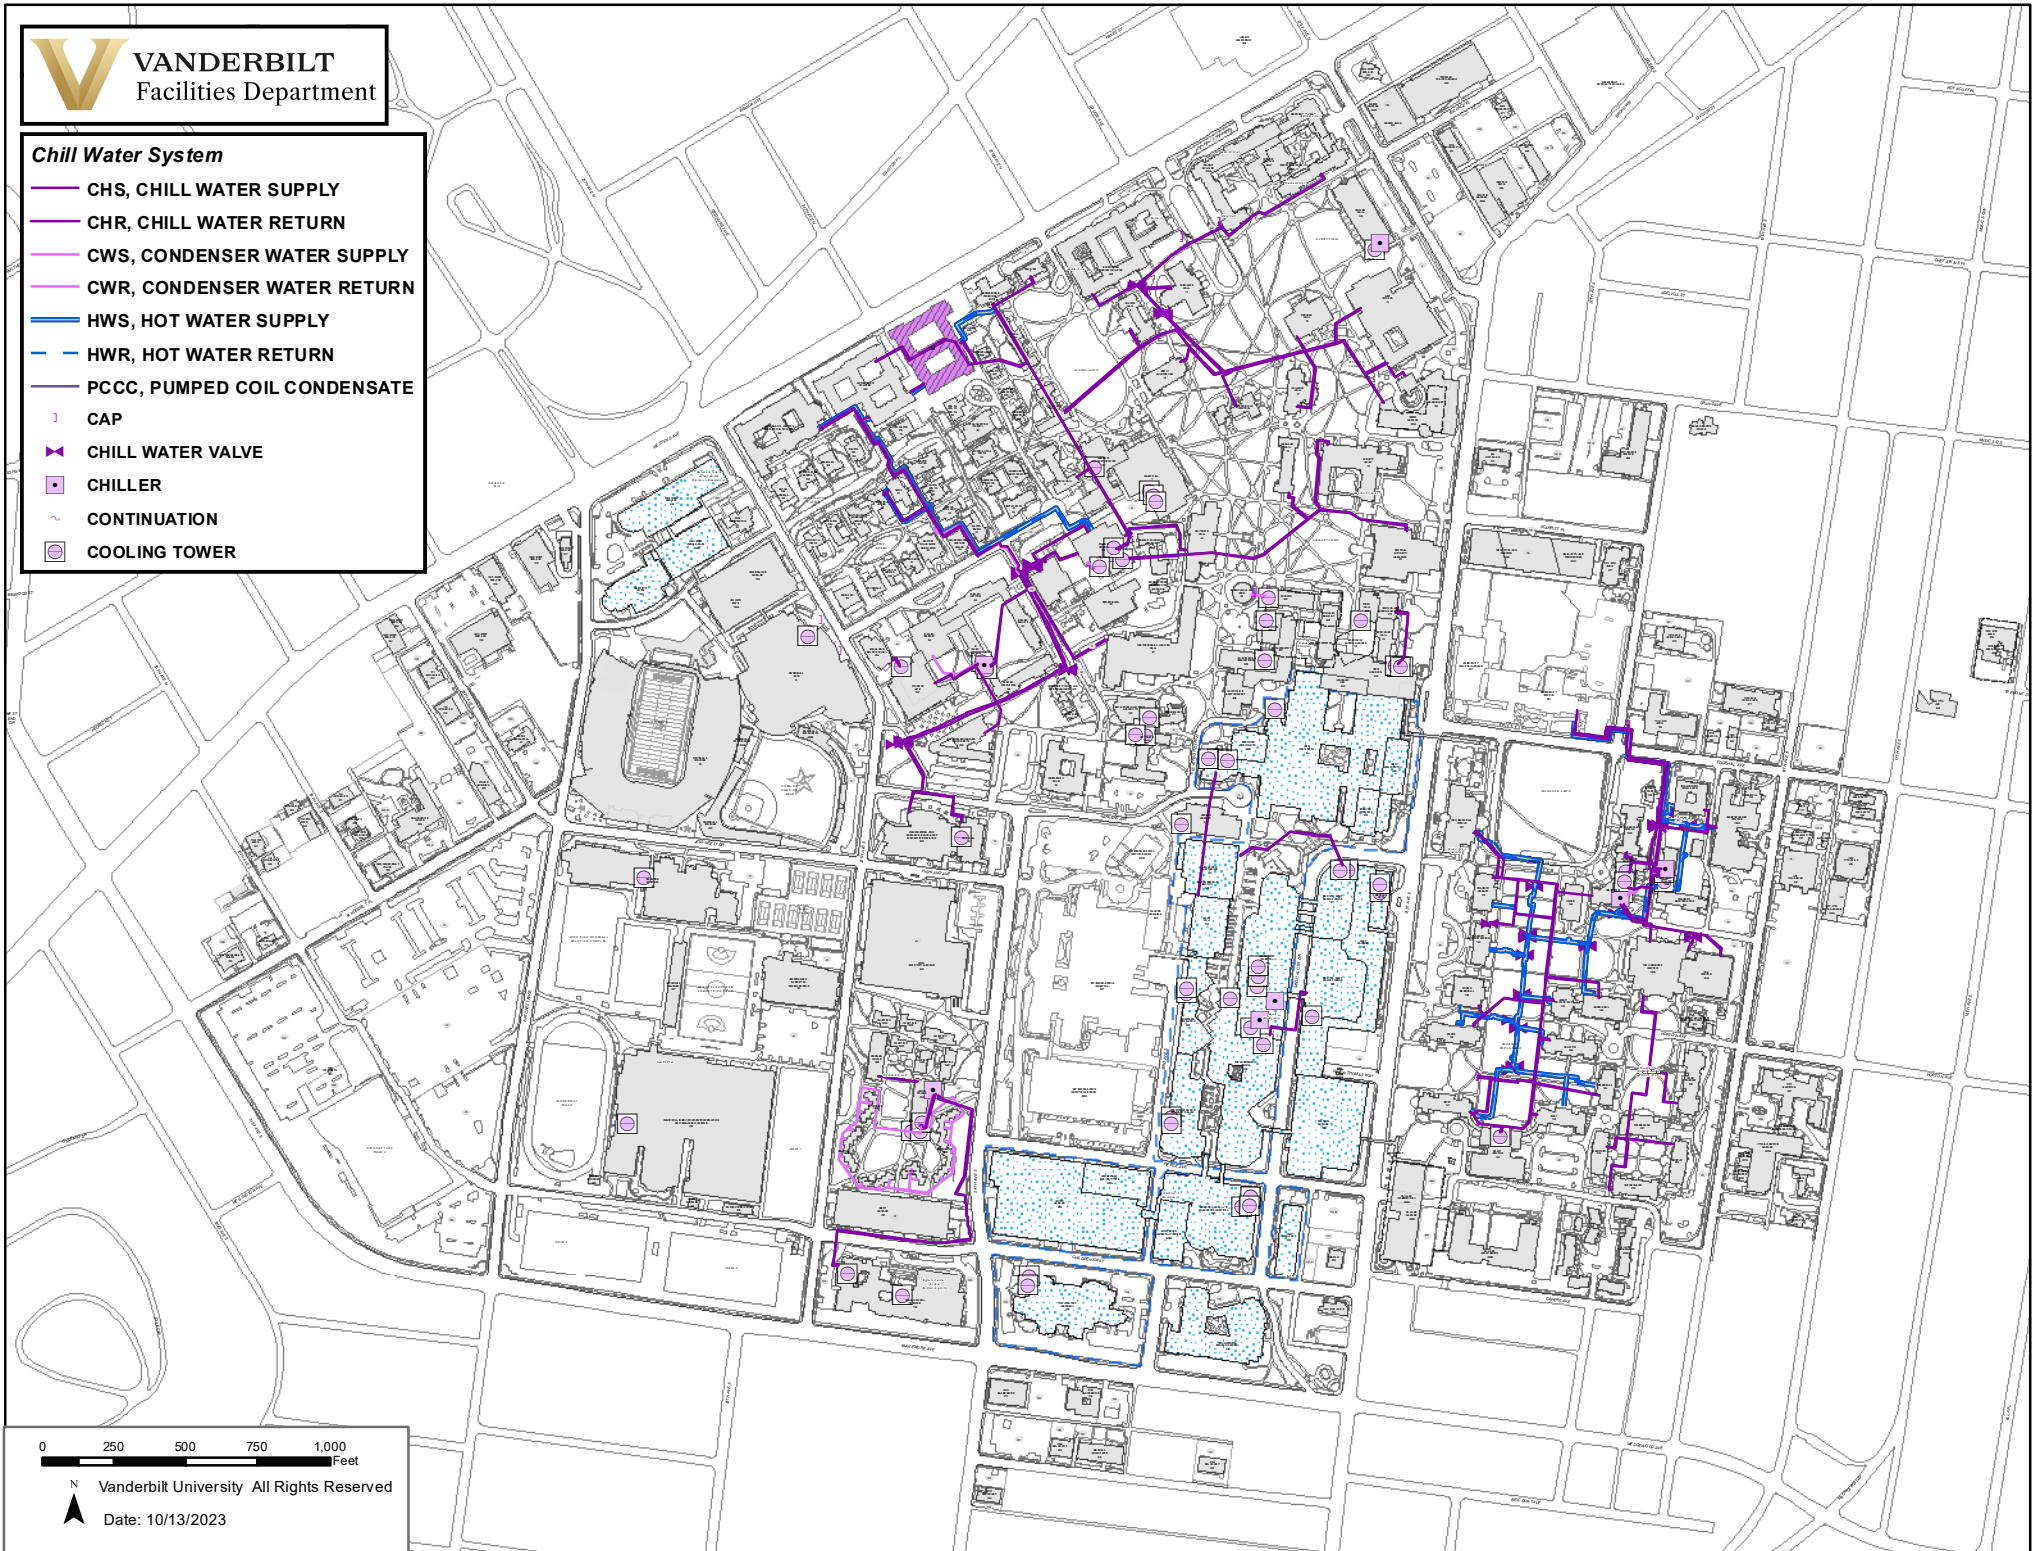

Vanderbilt University All Rights Reserved

Date: 10/13/2023