















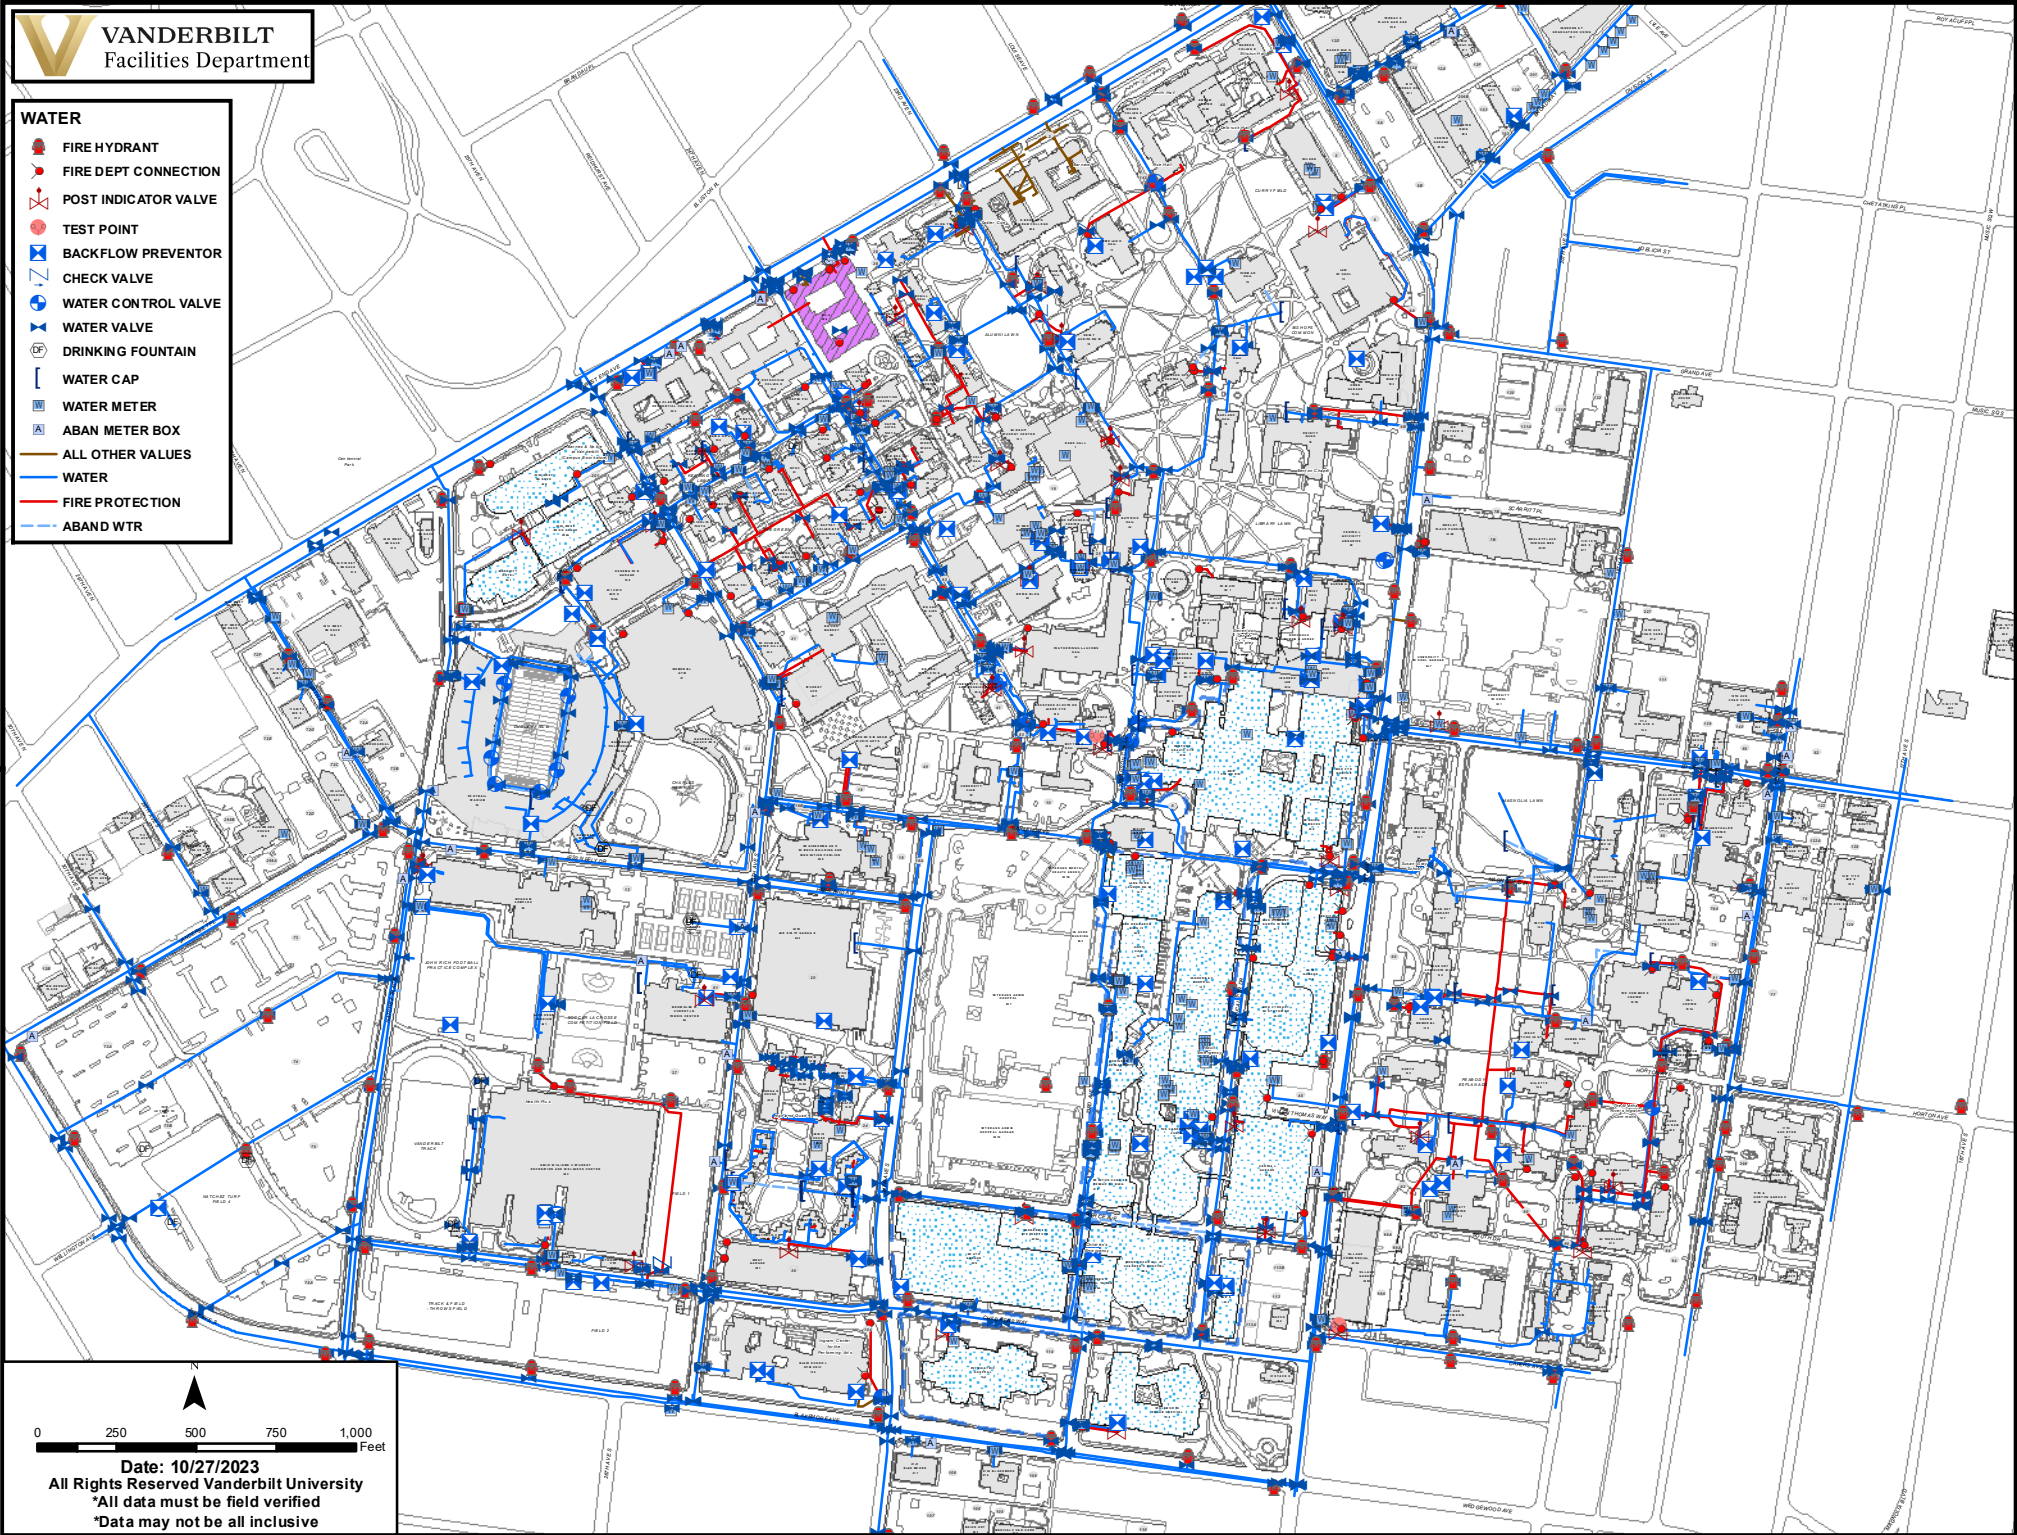


- WATER**
-  FIRE HYDRANT
 -  FIRE DEPT CONNECTION
 -  POST INDICATOR VALVE
 -  TEST POINT
 -  BACKFLOW PREVENTOR
 -  CHECK VALVE
 -  WATER CONTROL VALVE
 -  WATER VALVE
 -  DRINKING FOUNTAIN
 -  WATER CAP
 -  WATER METER
 -  ABAN METER BOX
 -  ALL OTHER VALUES
 -  WATER
 -  FIRE PROTECTION
 -  ABAND WTR



Date: 10/27/2023
 All Rights Reserved Vanderbilt University
 *All data must be field verified
 *Data may not be all inclusive